


**BCD Proposal OSSC10-49**

**1109.10.11.2 Size and spacing of handrails and grab bars.** Grab bars shall have an outside diameter of not less than 1 1/4 inches (32 mm) or more than 1 1/2 inches (38 mm). Handrails shall have an outside diameter of not less than 1 1/4 inches (32 mm) or more than 2 inches (51 mm) **and shall comply with Section 1012.3.** Handrails and grab bars shall provide a clearance of 1 1/2 inches (38 mm) between the handrail or grab bar and the wall (see ADAAG Figure 39).

(Also modify ADAAG Fig 39 as indicated below)

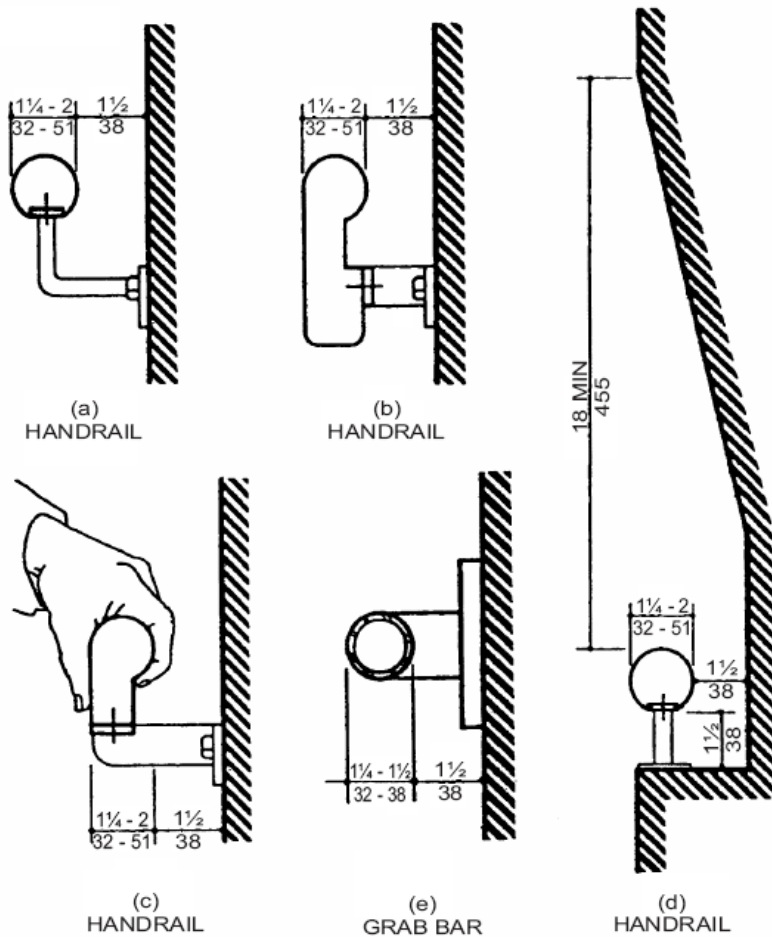

**Handrails shall also comply with Section 1012.3**

Grab bars (d) = 1 1/4" to 1 1/2" (32 mm to 38 mm)

Handrails (d) = 1 1/4" to 2" (32 mm to 51 mm)

**ADAAG FIGURE 39  
SIZE AND SPACING OF HANDRAILS AND GRAB BARS**