


This box is located in Section G2412 (C401)

Notice of installation. A "Notice of Installation" is required by the State Fire Marshal for all LP-gas tank installations. For installation requirements of LP-gas tanks and tubing or piping up to the first stage regulator see Chapter 38 of the *Fire Code*.

L.P.G.

Point of Delivery

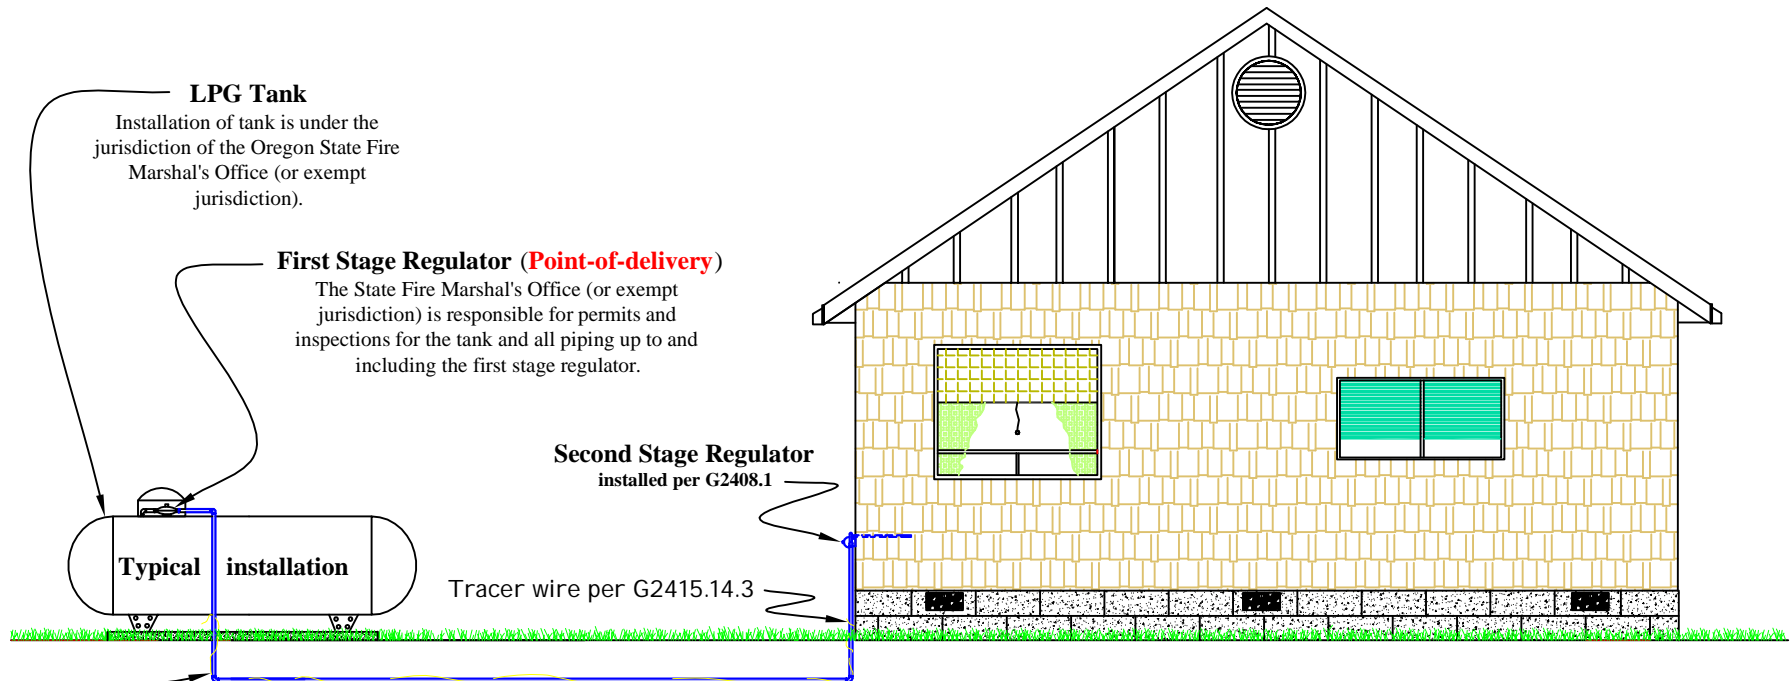

Permits and inspections for gas piping from first stage regulator to appliances is the responsibility of the local jurisdiction.

*** This box is located at the end of Section G2413 (C402)**

License requirements. LP-gas installers must be licensed by the State Fire Marshal in accordance with ORS 480.432 through 480.436.

* This includes home owners. For clarification of the Fire Marshal's Statutes call 503-373-1540.

For questions concerning installations from the point of delivery to the appliance contact Micheal D Ewert at mike.d.ewert@state.or.us or 503-373-7529.